


FIXED POINT MIXED HEATING ZONE



MIXED ZONE WITH THERMOSTATIC VALVE

OBJECT	INSULATION	MOTOR	PUMP
MIXED WITH THERM. VALVE	NO	NO	UPM3

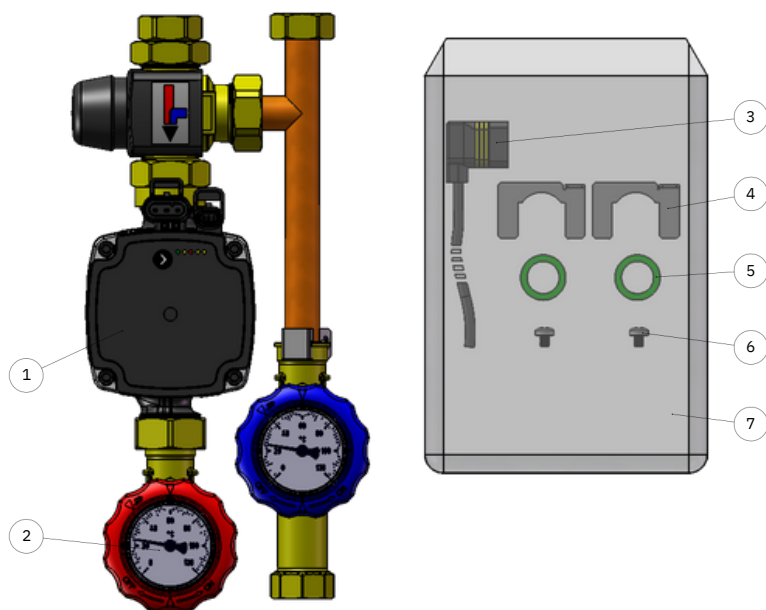

Composition

- 1) Subassembly
- 2) Thermometer
- 3) Cable
- 4) Bracket
- 5) Flat Gasket
- 6) Screw
- 7) Box

Certifications

- Pressure equipment (PED 2014/68/EU)
- Safety components (UNI EN ISO 4126:2019)
- Ball valves (UNI EN 1328:2004)
- Ball valves for gas (UNI EN 331:2015)
- Components for drinking water (KTW GUIDELINE and W270)

