


## MOTORIZED MIXED HEATING AND COOLING ZONE



### MOTORIZED MIXED ZONE

OBJECT	INSULATION	MOTOR	PUMP
MIXED MOTORIZED	YES	YES	UPM3-K

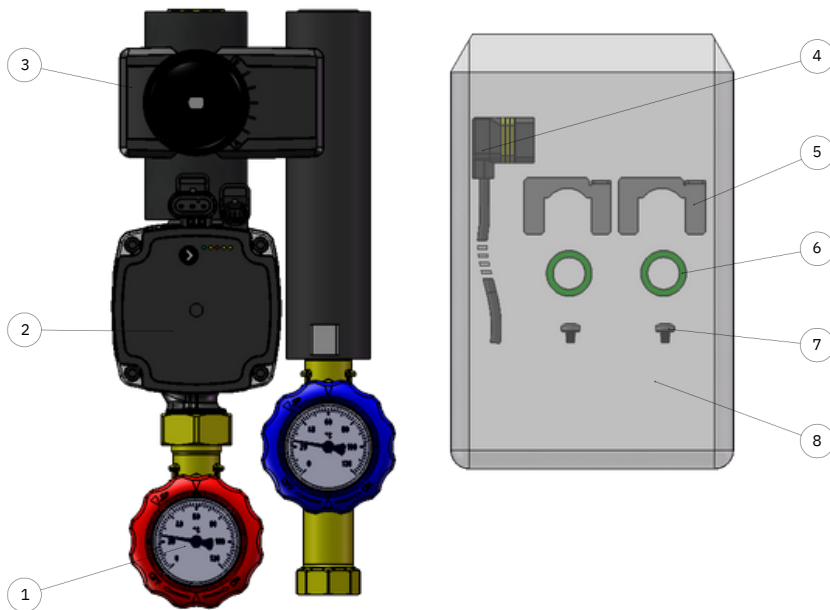

### Composition

- 1) Thermometer
- 2) Subassembly
- 3) NVM Motor
- 4) Cable
- 5) Bracket
- 6) Flat Gasket
- 7) Screw
- 8) Box

### Certifications

- Pressure equipment (PED 2014/68/EU)
- Safety components (UNI EN ISO 4126:2019)
- Ball valves (UNI EN 1328:2004)
- Ball valves for gas (UNI EN 331:2015)
- Components for potable water (KTW and W270 GUIDELINES)

